

# An Experimental Study on Utilization of Pulverized Plastic in Concrete as Fine Aggregates

K.E. Prakash<sup>\*1</sup>, Sangeetha D.M.<sup>\*2</sup>, Naveen Kumar D.T<sup>\*3</sup>, Trevorshefield<sup>\*4</sup>

Department of Civil Engineering, Shree Devi Institute of Technology, Mangalore.

Department of Civil Engineering, A.J. Institute of Engineering and Technology, Mangalore.

Department of Civil Engineering, SJB Institute of Technology, Bangalore

Department of Civil Engineering, Shree Devi Institute of Technology, Mangalore

<sup>1</sup>[keprakashpaper@gmail.com](mailto:keprakashpaper@gmail.com)

<sup>2</sup>[dr7795787676r@gmail.com](mailto:dr7795787676r@gmail.com)

<sup>3</sup>[naveendt012@gmail.com](mailto:naveendt012@gmail.com)

<sup>4</sup>[trevorsphawa@gmail.com](mailto:trevorsphawa@gmail.com)

**Abstract**— The construction industry suffers nowadays with lack of materials, mainly fine aggregates and increase in material costs. To reduce this, in this research, an attempt is made to replace used plastic as fine aggregate in the concrete. Plastic wastes are used in the form of pulverized plastic after undergoing the conversion process. Then, its suitability in concrete is tested by conducting tests like compression strength and split tensile strength test. From the results, a discussion is made on the effective percentage of replacement of utilized plastic in concrete. Thus, this helps in reducing plastic waste to be in a harmful state for our environment and is converted to an useful ingredient in concrete.

**Keywords**— Used Plastic, Fine Aggregate, Concrete, Compressive Strength, Split Tensile Strength

## I. INTRODUCTION

Due to the swift evolution in the population and development in the country, lots of infrastructure enlargement are taking place. For such infrastructural projects, concrete is an effective building component which rules the world. The main ingredient of Concrete is the fine aggregate. Now construction industry is facing the paucity of fine aggregates. Hence, a trial is made to replace the fine aggregate by the used plastic waste in the pulverized form. The suitability of this replacement is checked by conducting the tests in 7 and 14 days compressive strength, also the split tensile strength tests are conducted for the same.

## II. MATERIALS

### A. Plastic and Sand as Fine Aggregates

The intention of this project is to evaluate the opportunity, of using Low Density Poly Ethylene (LDPE) bags as a substitute for the fine aggregate in concrete. Plastic has a major advantage such as durability, low weight, insulation property and high strength. Still, tests are made to confirm the same. LDPE bags are gathered from the dumping area and washed with water. Plastics are cut into pieces, made to dry thoroughly and it was heated, until they got melted. Melting of plastic was carried out at a temperature of 110 °C-120 °C. The soft plastic were poured into the container and then it was allowed to harden. Then it is broken into pieces which is fed into the pulverising machine. Then it is turned into the size of the sand.. The LDPE used in this project work is brownish white in color. The concrete mixes are arranged varying the Low Density Polyethylene content as 0%, 10%, 20%, 30% and 40% by weight with substitution of sand. The grading of sand conforming to IS 383:1970 is used in this work.

### B. Cement and Coarse Aggregates

53 grade cement compatible to IS12269-1987 is used. The crumpled angular coarse aggregate which is collected from the nearby area is used, as termed in IS 2386 (Part I): 1963.

### C. Water

The water used is of good quality, free from any external agent which retard the quality of concrete and its pH value is in the range of 6 to 7.

### III. REVIEW OF LITERATURE

Concrete though replaced with many alternatives for its ingredients, a proper ingredient is required which does some added value to the environment, thus in that basis many researches have tried their best to satisfy both the quality of concrete and the environment which is evidenced from [1] through [10].

### IV. CONCRETE

M30 grade of concrete is planned using 53 grade Dalmia Cement and 0.45 Water with Cement Fraction. Cubes of size 100x100x100 mm were casted by filling up concrete in moulds up-to 3 layer, by applying a tamping rod of 25 blows in each layer and every time by changing the percentage of LDPE i.e. 40%, 30%, 20%, 10% and 0% in the weight of Fine aggregate. The cubes was de-moulded after 24 hours and reserved in the curing container for curing, and then it was tested after 7days, 14 days and 28 days. Later test results with optimum value is considered.




**Fig. 1 Concrete Cube Moulds**



**Fig.2 Concrete Cylinder Moulds**



**Fig. 3 Curing of Concrete Cubes**

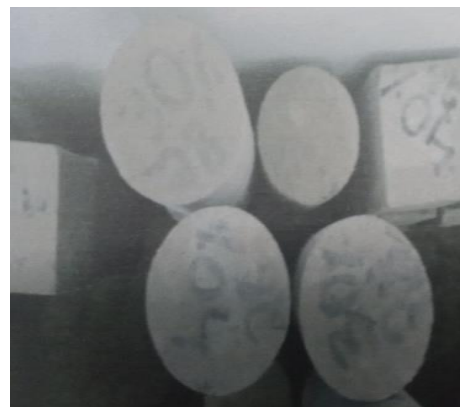

**Fig. 4 Curing of Concrete Cylinders**

#### A. Compressive Strength

It is the strength of the concrete to resist the compressive load. The test is done on cubes after drying those in normal room temperature. After curing for 7, 14 and 28 days. In a compression testing machine,

load is gradually acted at 300 KN per minute at a controlled rate. The peak load at which cube break were noted.

Compressive Strength = “L/A” N/mm<sup>2</sup>, L is the Failure load in N, A is the Area of cube in mm<sup>2</sup>

*B. Split tensile Strength*

This test is done on concrete cylinders of 150x300 mm size. The testing is done on concrete Cylinder after 7, 14 and 28 days of curing. Split tensile strength  $T = 2P/\pi DL$  P = Load, D = Diameter of the cylinder mould L = Length of cylinder mould



**Fig. 5 Compression Testing**



**Fig. 6 Split Tensile Testing**



**Fig. 7 Failed Cylinder**


V RESULTS AND DISCUSSION

The tests are conducted on 3 samples for each type for both Compressive strength and Split tensile strength tests and the results obtained are tabulated below and from the inference of the graphs plotted, an optimum amount of LDPE to be added is decided.

**TABLE I  
 COMPRESSIVE STRENGTH TEST RESULTS AT 7 DAYS**

Replacing of sand by pulverized plastic	Weight (kg)	Density (kg/m <sup>3</sup> )	Average density (kg/m <sup>3</sup> )	Failure Load (KN)	Compressive strength (N/mm <sup>2</sup> )	Average compressive strength(N/m <sup>2</sup> )
0% LDPE+100% FA	2.47	2470	2446.67	346.5	34.65	34.58
	2.41	2410		341.7	34.17	
	2.46	2460		349.2	34.92	
	2.34	2340		388.4	38.84	

10 % LDPE+90% FA	2.33	2330	2333.33	390.1	39.01	38.91
	2.33	2330		388.9	38.89	
20% LDPE+80% FA	2.20	2200	2200	322.3	32.23	32.69
	2.22	2220		328.9	32.89	
	2.18	2180		329.5	32.95	
30% LDPE+70% FA	2.16	2160	2136.66	312.4	31.24	31.10
	2.14	2140		309.3	30.93	
	2.11	2110		311.5	31.15	
40% LDPE+60% FA	2.00	2000	2010	219.8	21.98	21.73
	2.01	2010		216.9	21.69	
	2.02	2020		215.3	21.53	

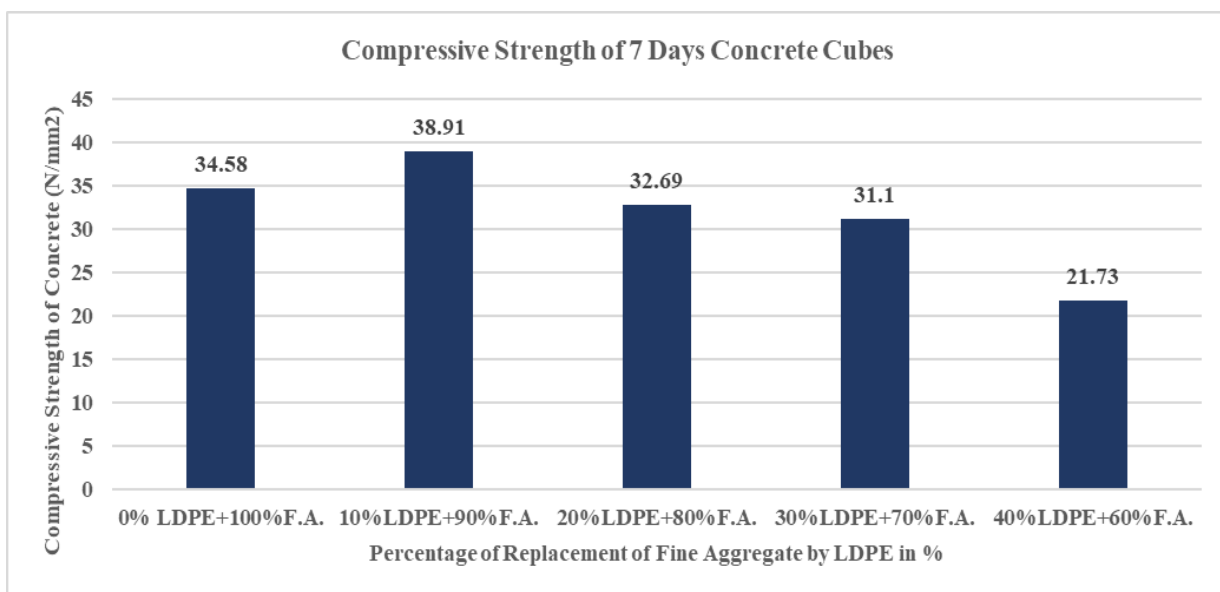


**Fig. 8 Compressive Strength of cubes after 7days**

At 7 Days, Compressive strength is highest in 10% replacement only compared to all its counterparts

**.TABLE II**  
**COMPRESSIVE STRENGTH TEST RESULTS AT 14 DAYS**

Replacement of Fine aggregate by LDPE	Weight (kg)	Density (kg/m <sup>3</sup> )	Average density (kg/m <sup>3</sup> )	Failure Load (KN)	Compressive strength (N/mm <sup>2</sup> )	Average compressive strength (N/mm <sup>2</sup> )
0% LDPE+100% FA	2.46	2460	2460	385.0	38.50	38.69
	2.47	2470		386.7	38.67	
	2.45	2450		389.2	38.92	
10 % LDPE+90% FA	2.34	2340	2303.3	402.1	40.21	40.17
	2.33	2330		401.2	40.12	
	2.34	2340		401.9	40.19	
20% LDPE+80% FA	2.23	2230	2226.6	352.3	35.23	35.54
	2.22	2220		354.6	35.46	
	2.23	2230		359.5	35.95	
30% LDPE+70% FA	2.10	2100	2133.3	325.4	32.54	32.45
	2.14	2140		319.1	31.91	
	2.16	2160		329.3	32.93	
40% LDPE+60% FA	2.01	2010	2003.3	239.8	23.98	23.70
	1.99	1990		236.9	23.69	
	2.01	2010		234.4	23.44	

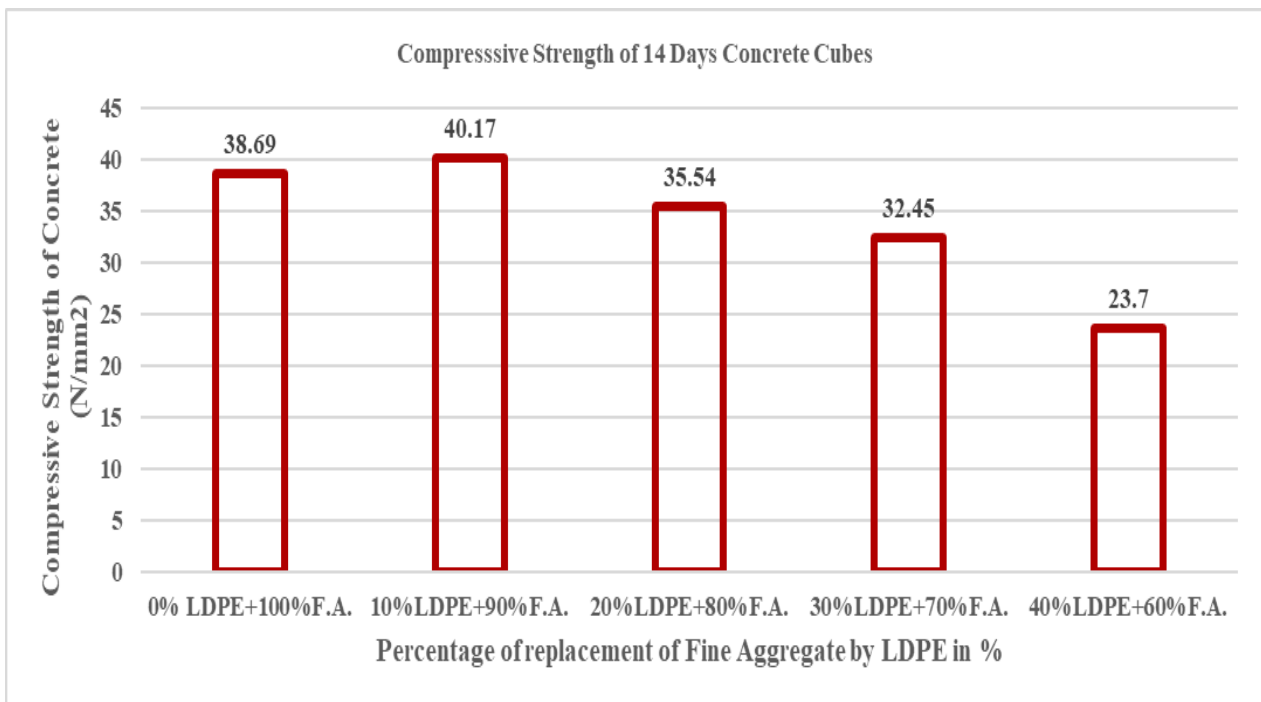


**Fig. 9 Compressive Strength of cubes after 14 days**

At 14 Days, Compressive strength is highest in 10% replacement only compared to all its counterparts.


**TABLE III**  
**COMPRESSIVE STRENGTH TEST RESULTS AT 28 DAYS**

Replacement of Fine aggregate by LDPE	Weight (kg)	Density (kg/m <sup>3</sup> )	Average density (kg/m <sup>3</sup> )	Failure Load (KN)	Compressive strength (N/mm <sup>2</sup> )	Average compressive strength (N/mm <sup>2</sup> )
0% LDPE+100% FA	2.46	2460	2450	435.3	43.53	43.52
	2.44	2440		435.4	43.54	
	2.45	2450		434.9	43.49	
10 % LDPE+90% FA	2.35	2350	2343.33	452.3	45.23	45.22
	2.35	2350		451.8	45.18	
	2.33	2330		452.5	45.25	
20% LDPE+80% FA	2.23	2230	2226.6	372.3	37.23	37.36
	2.22	2220		374.6	37.46	
	2.23	2230		373.9	37.39	
30% LDPE+70% FA	2.15	2150	2143.33	352.4	35.24	35.33
	2.15	2150		353.6	35.36	
	2.13	2130		353.9	35.39	
40% LDPE+60% FA	2.01	2010	2016.67	259.8	25.98	25.91
	2.03	2030		258.7	25.87	
	2.01	2010		258.9	25.89	

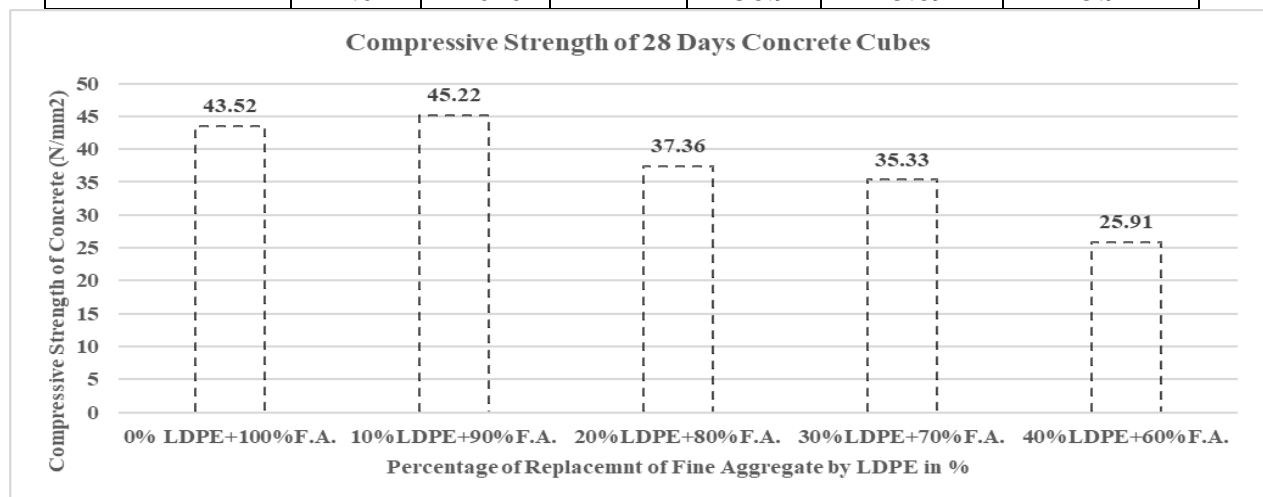

**Fig. 10 Compressive Strength of cubes after 28 days**

At 28 Days, Compressive strength is highest in 10% replacement only compared to all its counterparts.

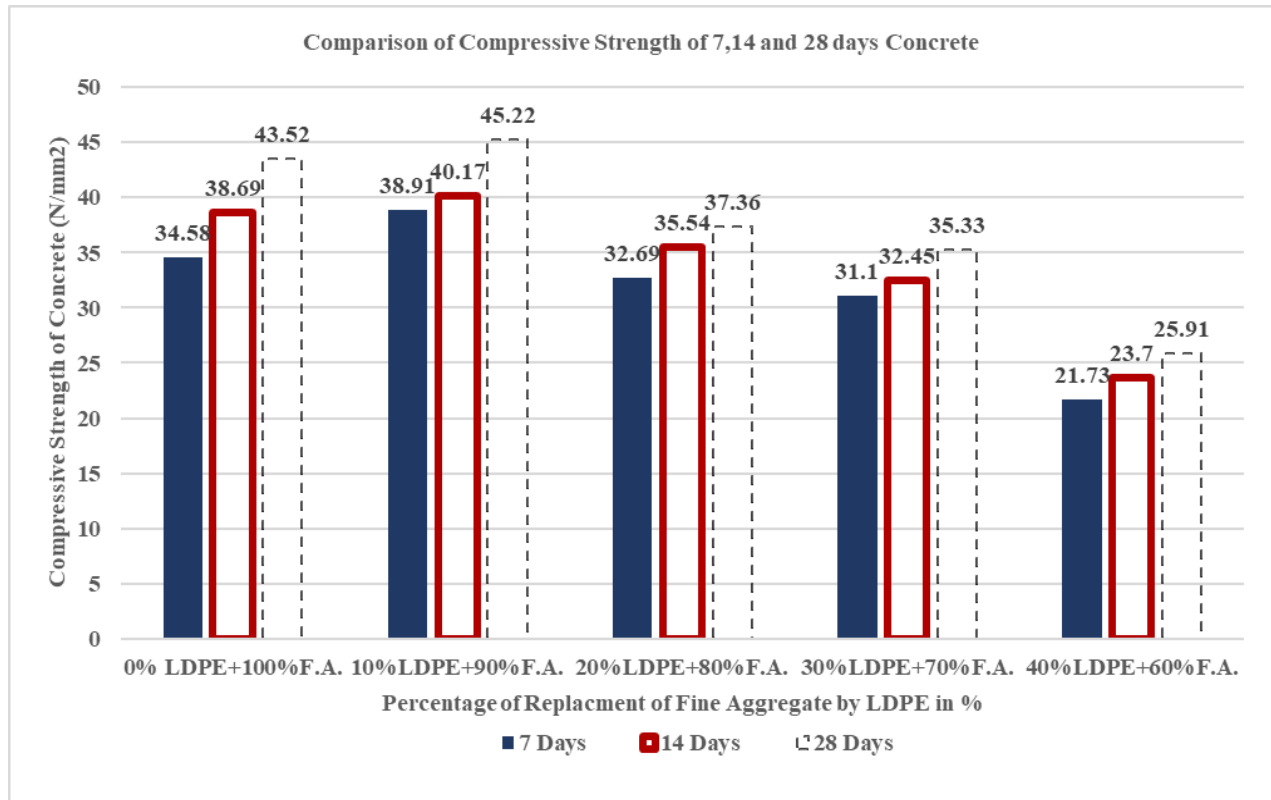

**Fig. 11 Comparison of Compressive Strength of cubes after 7, 14 and 28 days**

From the graphs, it has been ascertained that the compressive strength of cubes with the LDPE 10% LDPE + 90% FA increases, after that the compressive strength decreases, therefore it can be concluded that the optimum compressive strength is at 10% LDPE + 90% FA.

**TABLE IV  
SPLIT TENSILE STRENGTH TEST RESULTS AT 7 DAYS**

Replacement of Fine aggregate by LDPE	Weight (kg)	Density (kg/m <sup>3</sup> )	Average density (kg/m <sup>3</sup> )	Failure Load (KN)	Split tensile strength (N/mm <sup>2</sup> )	Average Split tensile strength (N/mm <sup>2</sup> )
0% LDPE+100% FA	14.04	2649.0	2641.5	169.03	2.39	2.39
	13.95	2632.1		171.1	2.40	
	14.01	2643.4		168.2	2.38	
	13.80	2603.7		187.9	2.66	

10% LDPE+90% FA	13.82	2607.5	2602.5	191.0	2.68	2.66
	13.76	2596.2		186.5	2.65	
20% LDPE+80% FA	13.60	2566.0	2561.6	181.36	2.55	2.53
	13.58	2562.3		180.12	2.53	
30% LDPE+70% FA	13.45	2537.7	2540.2	164.5	2.35	2.35
	13.48	2543.4		165.0	2.37	
40% LDPE+60% FA	13.46	2539.6	2469.2	163.0	2.33	2.15
	13.13	2477.4		157.5	2.17	
FA	13.10	2471.7	2469.2	152.2	2.15	2.15
	13.03	2458.5		150.2	2.13	

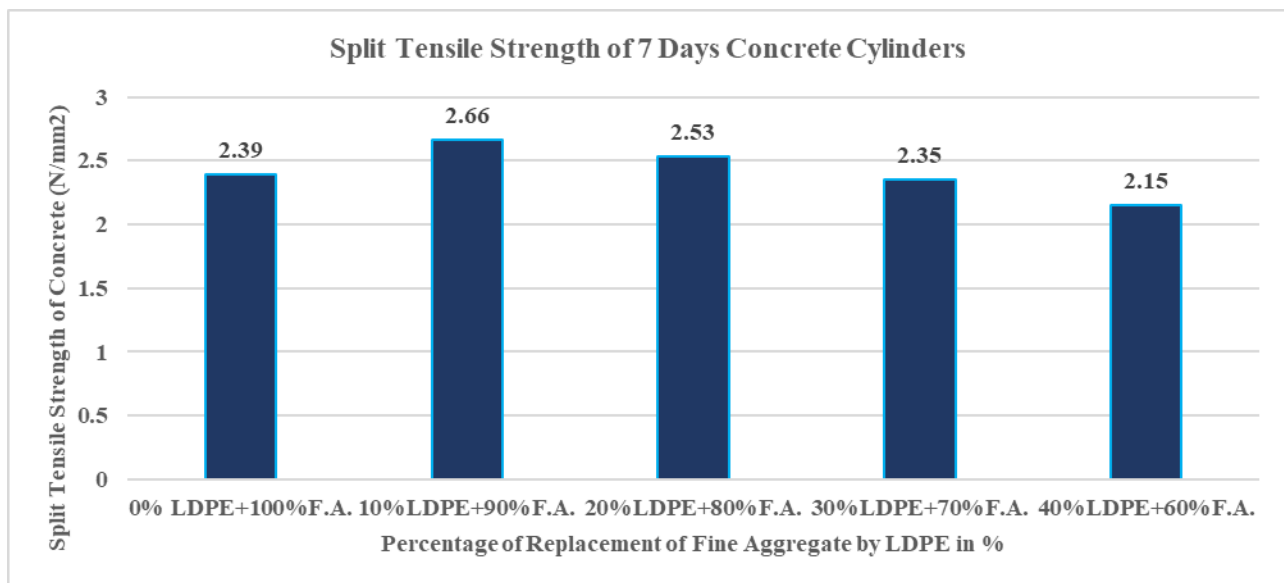


Fig. 12 Split tensile Strength of cylinder after 7 days


At 7 Days, Split Tensile strength is highest in 10% replacement only compared to all its counterparts.

TABLE V

SPLIT TENSILE STRENGTH TEST RESULTS AT 14 DAYS

Replacement of Fine aggregate by LDPE	Weigh t (kg)	Densit y (kg/m <sup>3</sup> )	Averag e density (kg/m <sup>3</sup> )	Failur e Load (KN)	Split tensile strength (N/mm <sup>2</sup> )	Average Split tensile strength (N/mm <sup>2</sup> )
0% LDPE+100% FA	13.95	2632.1	2641.5	259.3	3.67	3.68
	14.01	2643.4		260.12	3.68	
	14.04	2649.0		261.2	3.69	
10 % LDPE+90% FA	13.76	2596.2	2602.5	282.0	3.98	4.03
	13.80	2603.7		285.0	4.03	
	13.82	2607.5		289.0	4.08	

20% LDPE+80% FA	13.55	2556.6	2561.6	280.1	3.96	3.98
	13.58	2562.3		281.32	3.98	
	13.60	2566.0		283.2	4.00	
30% LDPE+70% FA	13.45	2537.7	2540.23	255.0	3.60	3.68
	13.46	2539.6		261.5	3.70	
	13.48	2543.4		265.2	3.75	
40% LDPE+60% FA	13.13	2477.4	2469.2	235.0	3.33	3.36
	13.10	2471.7		238.2	3.37	
	13.03	2458.5		239.0	3.38	

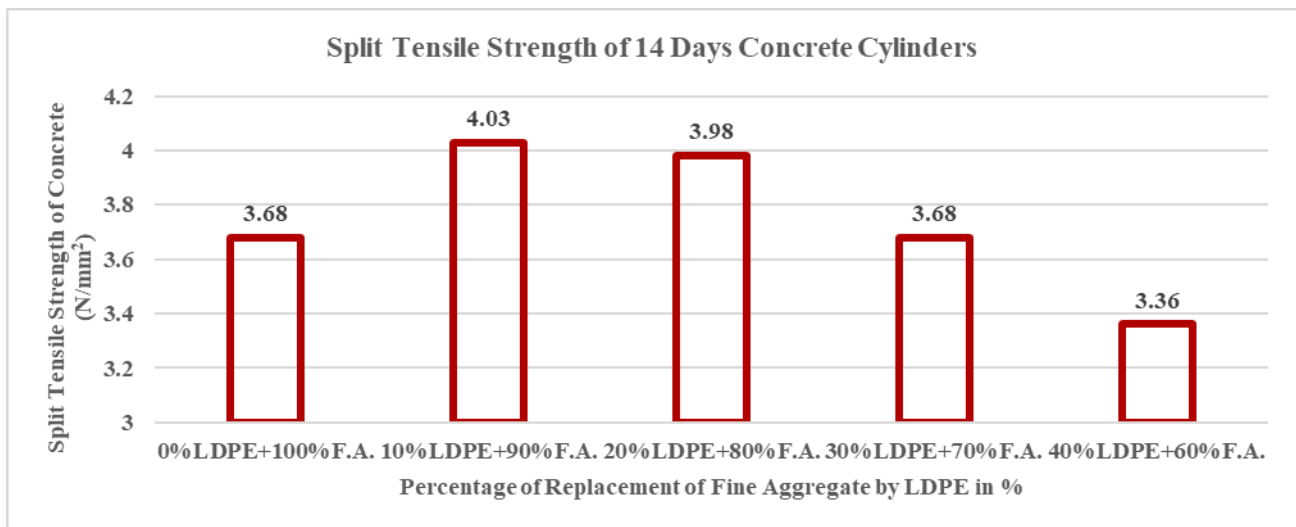

**Fig. 13 Split tensile Strength of cylinder after 14 days**


At 14 Days, Split Tensile strength is highest in 10% replacement only, compared to all its counterparts.

**TABLE VI**

**SPLIT TENSILE STRENGTH TEST RESULTS AT 28 DAYS**


Replacement of Fine aggregate by LDPE	Weight (kg)	Density (kg/m <sup>3</sup> )	Average density (kg/m <sup>3</sup> )	Failure Load (KN)	Split tensile strength (N/mm <sup>2</sup> )	Average Split tensile strength (N/mm <sup>2</sup> )
0% LDPE+100% FA	13.95	2632.1	2641.5	329.3	4.65	4.67
	14.01	2643.4		330.12	4.67	
	14.04	2649.0		331.2	4.68	
10% LDPE+90% FA	13.80	2603.7	2602.5	352.0	4.98	5.02
	13.82	2607.5		355.0	5.02	
	13.76	2596.2		359.0	5.08	
20% LDPE+80% FA	13.60	2566.0	2561.6	325.0	4.59	4.62
	13.58	2562.3		328.3	4.64	
	13.55	2556.6		327.5	4.63	
	13.45	2537.7		305.0	4.31	

30% LDPE+70% FA	13.48	2543.4	2540.23	308.2	4.36	4.35
	13.46	2539.6		309.0	4.37	
40% LDPE+60% FA	13.13	2477.4	2469.2	281.3	3.98	3.99
	13.10	2471.7		283.2	4.00	
	13.03	2458.5		283.6	4.01	

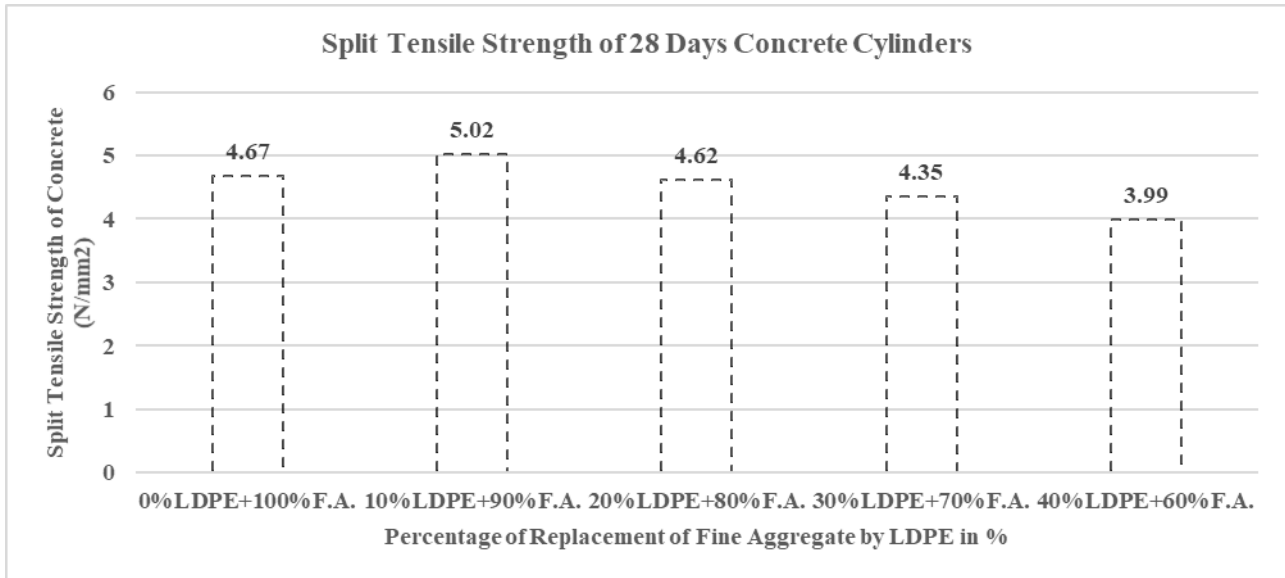

**Fig. 14 Split tensile Strength of cylinder after 28 days**

At 28 Days, Split Tensile strength is highest in 10% replacement only compared to all its counterparts.

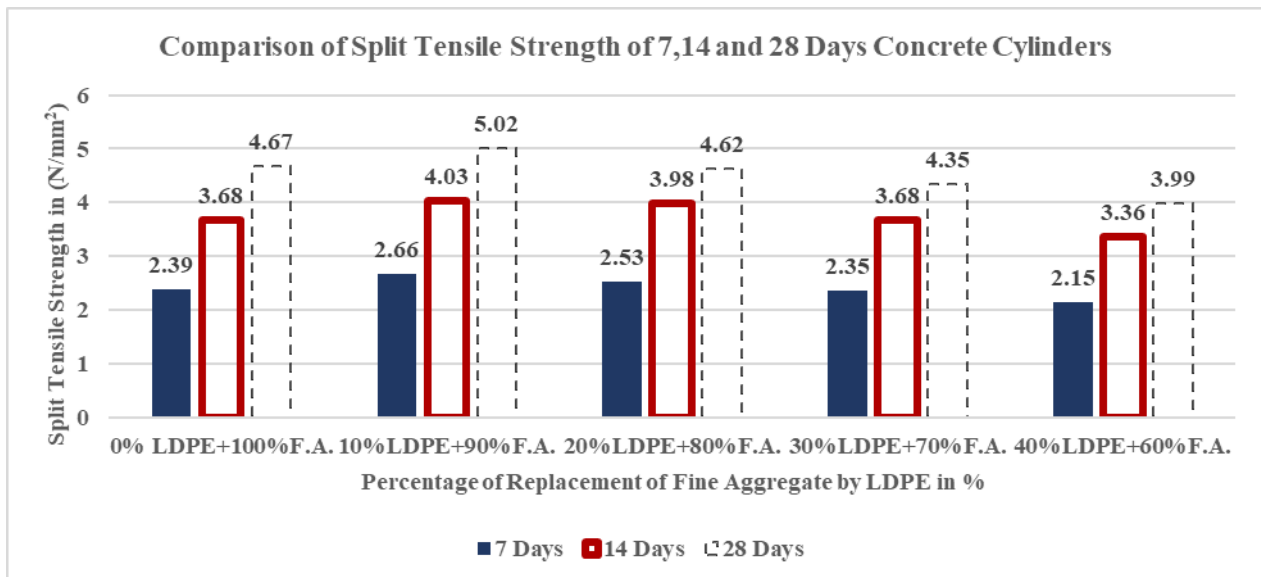

**Fig. 15 Comparison for Split tensile Strength of cylinder after 7, 14 and 28 days**

The graph indicates the Split Tensile Strength of cylinders after 7, 14 and 28 days. It had been ascertained that, the Split Tensile Strength increased at 10% LDPE + 90% F.A. After substitution, the Split Tensile Strength start decreasing, thus it can be concluded that the Split Tensile Strength is maximum at 10% LDPE +90% FA only.

#### VI CONCLUSIONS

The Compressive strength is increased by 3.91%, 3.83% and 12.52%, when replaced fine aggregate by 10% LDPE than compared with 100% fine aggregate for 28,14 and 7 Days. The split tensile strength is increased by 7.49% , 9.51% and 11.30% when replaced fine aggregate by 10% LDPE than compared with 100% fine aggregate for 28,14 and 7 Days. In both tests, the values start decreasing when there is a replacement of fine aggregate beyond 10%.

#### REFERENCES

- [1] L. R. Bhandodkar, A. A. Gaonkar, N. D. Gaonkar, & Y. P. Gauns “Pulverised PET Bottles as Partial Replacement for Sand”, International Journal of Earth Sciences and Engineering ISSN 0974-5904, Vol.04, pp. 1009-1012, October 2011.
- [2] Nitish Puri, Brijesh Kumar, Himanshu Tyagi “Utilization of Recycled Wastes as Ingredients in Concrete Mix” International Journal of Innovative Technology and Exploring Engineering ISSN:2278-3075, Vol. 2, Issue-2, January 2013.
- [3] Funso Falade, Efe Ikponmwoosa & Christopher Fapohunda “A Study on the Compressive and Tensile Strength of Foamed Concrete Containing Pulverized Bone as a Partial Replacement of Cement” Pak. J. Engg. & Appl. Sci. Vol. 13, pp. 82-93, January 2018
- [4] Daniel Yaw Osei “Experimental Investigation on Recycled Plastics As Aggregate In Concrete” International Journal of Structural and Engineering Research. ISSN 2319-6009. Vol. 3, No 2, pp. 168-174, May 2014.
- [5] T.Subramani, V.K.Pugal “Experimental Study On Plastic Waste As A Coarse Aggregate For Structural Concrete” International Journal of Application or Innovation in Engineering & Management (IJAIEM), ISSN 2319 – 4847 Issue 5, pp. 144-152, May 2015.
- [6] Dr Muhammad Maqbool Sadiq, Muhammad Rafique Khattak “Literature Review on Different Plastic Waste Materials Use in Concrete” Vol. 2, Issue 6, JETIR (ISSN-2349-5162. Pp. June 2015
- [7] R. Dharmaraj and G. Iyappan “Suitability of Partial Replacement of Pulverized Plastic as Fine Aggregate in Cement Concrete” Indian Journal of Science and Technology, Vol. 9(23), ISSN: 0974-6846, pp. 1-6, June 2016.
- [8] Dr.J.Premalatha1 and S.Afzal Ahamed “Experimental Study On Concrete with Plastic Aggregates” SSRG International Journal of Civil Engineering”, pp. 358-363, April 2017
- [9] Logachandran D, Kalaivani M “Feasibility Study on Plastic Wastes in Concrete” International Journal of Civil and Structural Engineering Research ISSN 2348-7607 (Online) Vol. 5, Issue 2, pp. 47-52, October 2017-March 2018.
- [10] Rafiq Ahmad Pirzada, Tapeshwar Kalra, Fayaz Ahmad Laherwal “Experimental Study on Use of Waste Plastic as Coarse Aggregate in Concrete with Admixture Super plasticizer Poly carboxylate Ether” International Research Journal of Engineering and Technology (IRJET) e-ISSN: 2395-0056 Vol. 05 Issue: 03, pp. 558-563, March 2018
- [11] IS 10262-2009, Bureau of Indian Standards Manak Bhavan, 9 Bahadur Shah Zafar Marg New Delhi 110002
- [12] IS 456-2000 Plain and Reinforced concrete – code of Practice. IS 516:1959 Method of Test for strength of concrete
- [13] IS 383-1970 (Reaffirmed 1997), Bureau of Indian Standards Manak Bhavan, 9 Bahadur Shah Zafar Marg New Delhi 110002.
- [14] M. S. Shetty “Concrete Technology- Theory and Practices, S Chand & Company Ltd, Ram Nagar, New Delhi, 1999”.